








FILE NAME: J:\2011\20110571 - Newport Naval Station Bldg 678 Electrical\Electrical\Plot Sheets\20110571 - ED105 ELECTRICAL FIFTH FLOOR DEMOLITION PLAN.dwg LAYOUT NAME: Work PLOTTED: Wednesday, April 10, 2013 - 10:01am USER: fdeaza

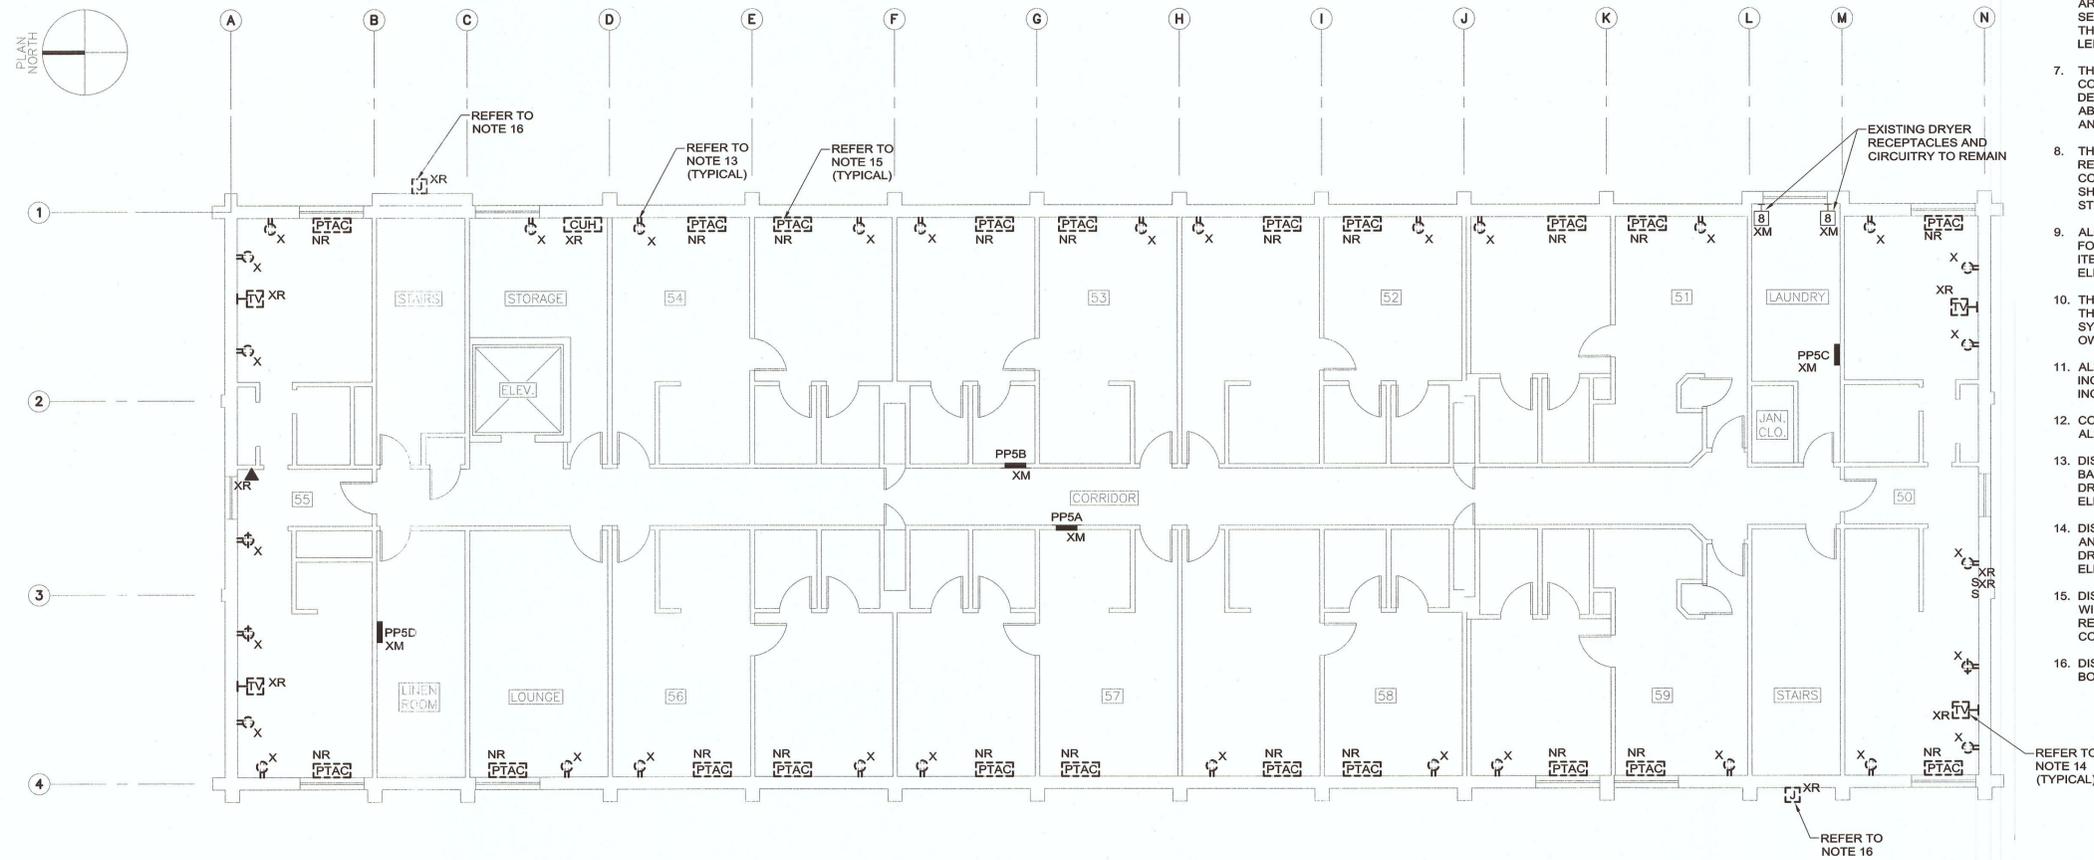

FIFTH FLOOR DEMOLITION PLAN

- DEMOLITION NOTES:**
- REFER TO DRAWING E000 FOR LEGEND AND SYMBOLS.
  - REFER TO THE ARCHITECTURAL DRAWINGS FOR THE FULL EXTENT OF THE SCOPE OF DEMOLITION AND PHASING PLANS/SCHEDULE. DISCONNECT, REMOVE AND MAKE SAFE ALL ELECTRICAL EQUIPMENT IDENTIFIED FOR REMOVAL. THE REMOVED EQUIPMENT SHALL BE SAFELY STORED AND THEN REINSTALLED PER THE ARCHITECTURAL PHASING PLAN. THE ELECTRICAL DEMOLITION LIMITS TO FULLY COMPLY WITH VARIOUS REQUIREMENTS DEFINED BY THESE NOTES.
  - THE ELECTRICAL DEMOLITION PLANS AND DETAILS INDICATE THE GENERAL INTENT AND ARE NOT INTENDED TO SHOW ALL ITEMS TO BE REMOVED OR RETAINED. THE ELECTRICAL CONTRACTOR SHALL VISIT THE SITE PRIOR TO THE SUBMISSION OF BIDS TO BECOME FAMILIAR WITH THE ACTUAL CONDITIONS AND EXTENT OF WORK. DEVICES AND EQUIPMENT LOCATED ON WALLS AND/OR CEILINGS TO BE REMOVED SHALL BE DISCONNECTED, REMOVED AND MADE SAFE AND THEN STORED FOR REINSTALLATION. THE ELECTRICAL CONTRACTOR SHALL NOTIFY THE OWNER'S REPRESENTATIVE OF ANY UNANTICIPATED HIDDEN CONDITIONS ENCOUNTERED DURING DEMOLITION.
  - THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR OF ALL SYSTEMS OR BUILDING COMPONENTS DAMAGED DURING THE EXECUTION OF THE WORK. DAMAGE SHALL INCLUDE BUT NOT BE LIMITED TO DESTRUCTION OR DISPOSAL OF ITEMS INTENDED TO REMAIN AND BE REINSTALLED.
  - THE ELECTRICAL CONTRACTOR SHALL CIRCUIT TRACE AND LABEL ALL EXISTING BRANCH CIRCUITS AND FEEDERS WITHIN THE AREA OF DEMOLITION SCOPE PRIOR TO DE-ENERGIZING AND DISCONNECTION. ALL CIRCUITS WITHIN PANELBOARDS IDENTIFIED FOR TEMPORARILY REMOVAL SHALL BE TRACED AND LABELED TO ENSURE THAT NO AREA OUTSIDE THE DEMOLITION SCOPE LIMIT IS AFFECTED.
  - THE ELECTRICAL CONTRACTOR SHALL IDENTIFY ALL BRANCH CIRCUITS, FEEDERS AND SYSTEM COMPONENTS, WHICH ARE TO REMAIN WITHIN THE AREA OF DEMOLITION SCOPE. THERE SHALL BE NO INTERRUPTION OF SERVICE TO ANY AREA OUTSIDE THE SCOPE LIMITS WITHOUT APPROVAL FROM THE OWNER'S REPRESENTATIVE. EXISTING EQUIPMENT TO REMAIN SHALL BE LEFT IN A CODE COMPLIANT MANNER.
  - THE ELECTRICAL CONTRACTOR SHALL DE-ENERGIZE, MAKE SAFE AND SECURE CONDUCTORS FOR EXTERIOR WALL REMOVAL WITHIN THE AREA OF DEMOLITION SCOPE. ITEMS IDENTIFIED FOR DEMOLITION SHALL NOT BE ABANDONED IN PLACE. ALL ITEMS REMOVED SHALL BE PROPERLY STORED AND THEN REINSTALLED UPON.
  - THE ELECTRICAL CONTRACTOR SHALL TEMPORARILY SUPPORT ALL ITEMS TO REMAIN THAT ARE AFFECTED BY THE DEMOLITION OF BUILDING STRUCTURAL COMPONENTS (WALLS, CEILINGS, ETC.). TEMPORARILY SUPPORTED ITEMS SHALL BE PERMANENTLY SUPPORTED AND REINSTALLED WHEN FINALIZED STRUCTURES ARE IN PLACE.
  - ALL REMOVED ITEMS SHALL BE PROPERLY STORED OF UNLESS IDENTIFIED FOR DISPOSAL. THE OWNER'S REPRESENTATIVE SHALL INSPECT ALL STORED ITEMS PRIOR TO PLACEMENT IN THE IDENTIFIED STORAGE LOCATION BY THE ELECTRICAL CONTRACTOR.
  - THE EXISTING FIRE ALARM SYSTEM SHALL REMAIN FULLY FUNCTIONAL DURING THE ENTIRE DEMOLITION AND CONSTRUCTION PERIOD. ALL REQUIRED SYSTEM SHUTDOWNS SHALL BE COORDINATED WITH AND APPROVED BY THE OWNER'S REPRESENTATIVE AND THE AUTHORITY HAVING JURISDICTION.
  - ALL DEMOLITION SCOPE ASSOCIATED WITH LOW VOLTAGE SYSTEMS INCLUDING BUT NOT LIMITED TO TELEPHONE, DATA, CCTV, ETC. SHALL BE INCLUDED IN THIS CONTRACT.
  - COORDINATE ELECTRICAL DISCONNECTION OF ALL NOTED EQUIPMENT WITH ALL OTHER TRADES.
  - DISCONNECT AND REMOVE RECEPTACLE COVER PLATES, RECEPTACLES AND BACK BOXES. MAKE SAFE EXISTING WIRING TO ALLOW FOR REMOVAL OF DRYWALL. REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR WALL ELEVATIONS, EXACT QUANTITIES AND LOCATIONS.
  - DISCONNECT AND TEMPORARILY REMOVE TELEPHONE AND/OR TV OUTLET AND BACK BOXES. MAKE SAFE EXISTING WIRING TO ALLOW FOR REMOVAL OF DRYWALL. REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR WALL ELEVATIONS, EXACT QUANTITIES AND LOCATIONS.
  - DISCONNECT AND REMOVE EXISTING PTAC UNIT AND ASSOCIATED CONTROL WIRING. EXISTING BRANCH CIRCUIT SHALL BE MADE SAFE TO ALLOW FOR REMOVAL OF DRYWALL. COORDINATE WORK WITH MECHANICAL CONTRACTOR.
  - DISCONNECT AND TEMPORARILY REMOVE WEATHERPROOF JUNCTION BOX/CONDUIT AND ASSOCIATED ANTENNA.

**RDK ENGINEERS**  
 Andover, MA - Boston, MA - Amherst, MA  
 Durham, NC - Charlotte, NC

DEPARTMENT OF THE NAVY  
 NAVAL FACILITIES ENGINEERING COMMAND  
 NEWPORT, RI  
 NAVAL STATION  
 EXTERIOR REPAIRS BUILDING 678  
 CODDINGTON POINT  
 ELECTRICAL DEMOLITION FIFTH FLOOR PLAN

SCALE: 1/8"=1'-0"

PROJECT NO.: 1116190  
 CONSTR. CONTR. NO.: N40065-11-D-7207-0502  
 NAVFAC DRAWING NO.: 12642120  
 SHEET 59 OF 66  
 ED105  
 DATE: 10 MARCH 2009

FOR COMMANDER NAVFAC ACTIVITY  
 APPROVED: [Signature]  
 SATISFACTORY TO DATE APRIL 12, 2013  
 DES DM DRW DM CHK GM  
 <<PJ/DMS>>  
 BRANCH MANAGER  
 CHIEF ENG/ARCH  
 <<ODS>>

GALE  
 Gale Associates, Inc.  
 Engineers Planners  
 163 LIBBEY PARKWAY  
 WEYMOUTH, MA 02189  
 P 781.335.6465  
 F 781.335.6467 www.gainc.com  
 Boston Baltimore Orlando San Francisco  
 GALE IN 824502 A/E INFO

NAVAFAC  
 NAVFAC  
 PROFESSIONAL ENGINEER  
 No. 7526  
 4-10-13

