


FILE NAME: J:\2011\20110571 - Newport Naval Station Bldg 678 Electrical\Electrical\Plot Sheets\20110571 - E102 ELECTRICAL LIGHTING & POWER SECOND FLOOR PLAN.dwg LAYOUT NAME: Work PLOTTED: Wednesday, April 10, 2013 - 10:01am USER: fdczsz

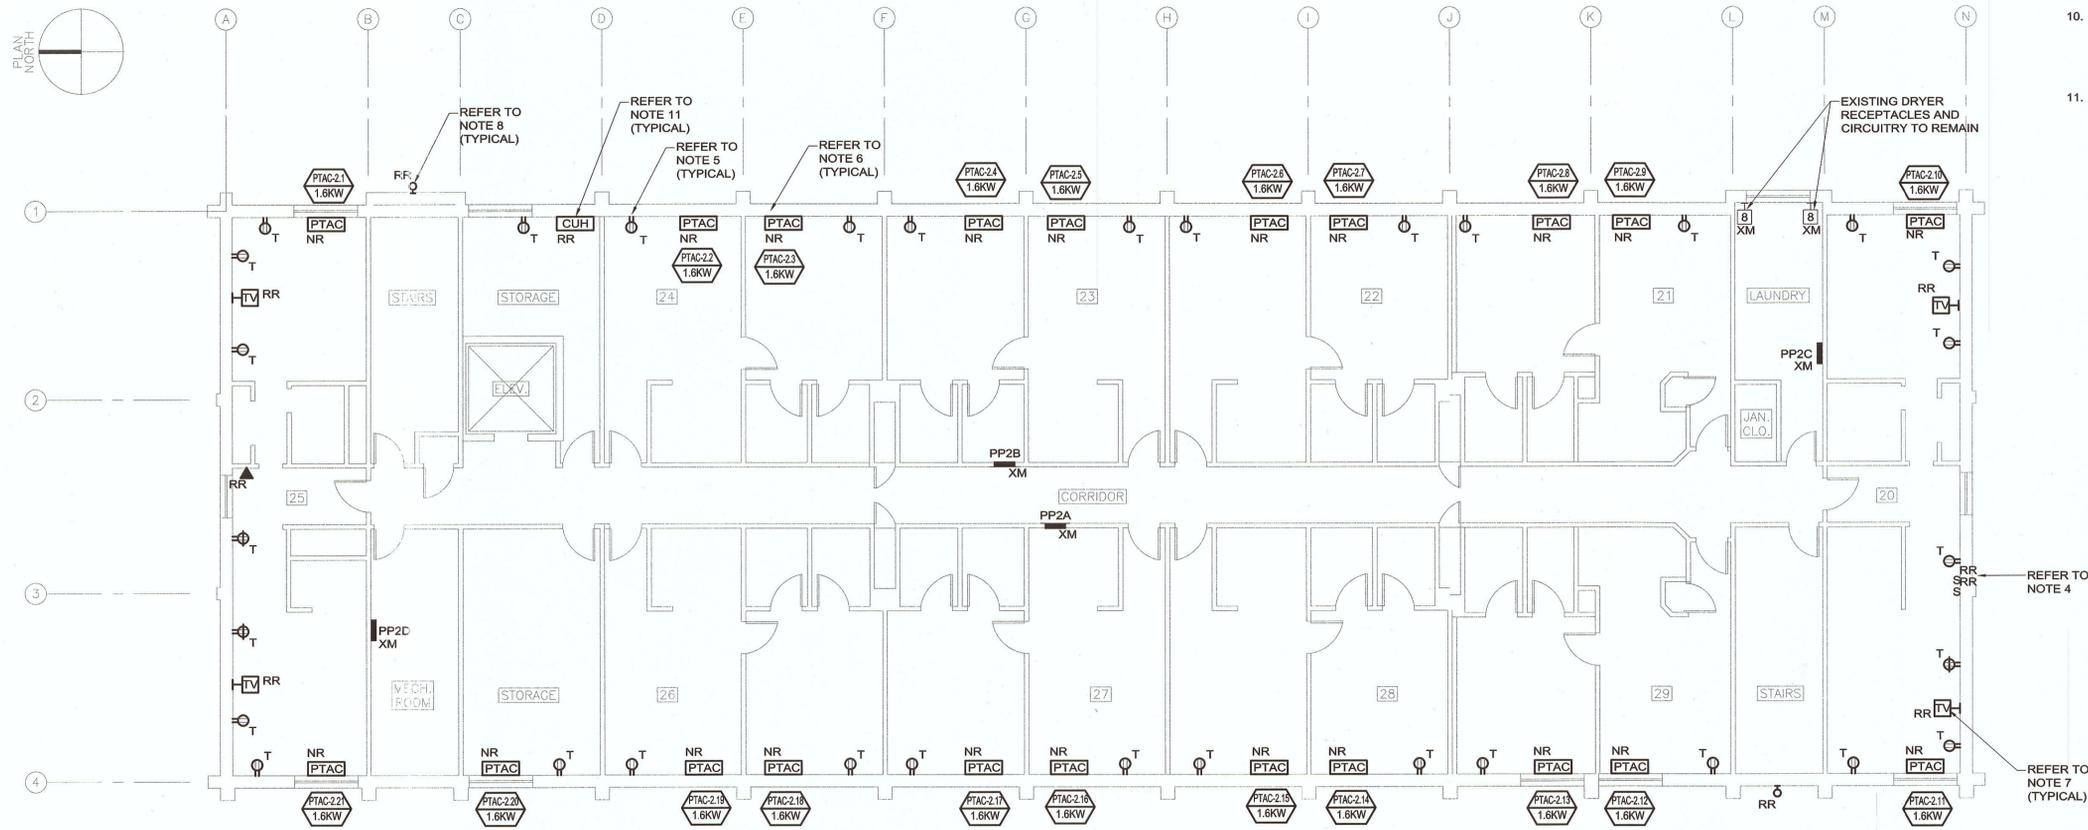

SECOND FLOOR NEW WORK PLAN


LIGHTING AND POWER NOTES:

1. REFER TO DRAWING E000 FOR LEGEND AND SYMBOLS.
2. REFER TO ARCHITECTURAL DRAWINGS, INCLUDING BUT NOT LIMITED TO FLOOR PLANS AND ELEVATIONS FOR ASSOCIATED NOTES.
3. BRANCH CIRCUITRY MAY BE TYPE MC CABLE WHERE CONCEALED ABOVE SUSPENDED CEILINGS OR IN METAL STUD WALLS.
4. REINSTALL BACK BOX AND RECONNECT MULTIPLE GANG SWITCH AND COMMON FACE PLATE IN EXISTING LOCATION PRIOR TO DEMOLITION.
5. INSTALL NEW BACK BOX AND EXTEND/RECONNECT EXISTING BRANCH CIRCUIT PREVIOUSLY SERVING THE RECEPTACLE TO EXISTING LOCATION PRIOR TO DEMOLITION. RECONNECT BRANCH CIRCUIT TO NEW TAMPER RESISTANT RECEPTACLE AND INSTALL NEW COVER PLATE TO MATCH EXISTING.
6. EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING PTAC UNIT AND RECONNECT TO NEW PTAC UNIT AND ASSOCIATED CONTROLS. UNLESS INDICATED OTHERWISE THE PTAC UNITS WILL BE FURNISHED WITH INTEGRAL DISCONNECT SWITCH. NOTE THAT WIRING TO THE PTAC UNITS WILL BE THROUGH AN ELECTRICAL SUBBASE WHICH HOUSES THE UNIT DISCONNECT SWITCH.
7. REINSTALL BACK BOX AND RECONNECT/INSTALL TELEPHONE AND/OR TV OUTLET TO EXISTING LOCATION PRIOR TO DEMOLITION.
8. RECONNECT/INSTALL EXISTING LIGHT FIXTURE TO EXISTING BRANCH CIRCUIT.
9. MAINTAIN CONTINUITY OF BRANCH CIRCUITRY ASSOCIATED WITH ALL EXISTING DEVICES AND LIGHTING TO REMAIN.
10. REINSTALL EXISTING RECEPTABLES, TELEPHONE/TV OUTLETS, COVER PLATES AND RECONNECT EXISTING BRANCH CIRCUIT WIRING FOR ALL INTERIOR WALL RECEPTABLES AND TELEPHONE/TV OUTLETS. REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR WALL ELEVATIONS FOR EXACT QUANTITIES AND LOCATIONS.
11. EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING CABINET UNIT HEATER AND RECONNECT TO REINSTALLED CABINET UNIT HEATER.



	DATE
	APPR
GILBERT E. MARTIN, JR. No. 7526 PROFESSIONAL ENGINEER	
Gale Associates, Inc. Engineers - Planners 163 LIBBEY PARKWAY WEYMOUTH, MA 02189 P 781.335.6465 F 781.335.6467 www.gainc.com Boston Baltimore Orlando San Francisco	
GALE # 024502 A/E # 03	
FOR COMMANDER NAFC ACTIVITY	
SATISFACTORY TO DATE APRIL 12, 2013	
DES DM DRW DM CHK GM <<P/N/DA>>	
BRANCH MANAGER CHIEF ENG/ARCH	
<<CODE>>	
DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND NAVAL STATION NEWPORT, RI NEWPORT, RI EXTERIOR REPAIRS BUILDING 678 CODDINGTON POINT NAVAL STATION NAVAL STATION ELECTRICAL LIGHTING & POWER SECOND FLOOR PLAN	
SCALE: 1/8"=1'-0" PROJECT NO: 1116180 CONSTRUCTION NO: W4005-11-D-7207-0502 NAVFAC DRAWING NO: 12642123 SHEET 62 OF 66 E102 T. 978-296-6200 ANDOVER, MA 01810-1488	
DRAWING REVISIONS TO MARCH 2009	

FILE NAME: J:\2011\20110571 - Newport Naval Station Bldg 678 Electrical\Electrical\Plot Sheet\20110571 - E104 ELECTRICAL LIGHTING & POWER FOURTH FLOOR PLAN.dwg LAYOUT NAME: Work PLOTTED: Wednesday, April 10, 2013 - 10:02am USER: fdeaco

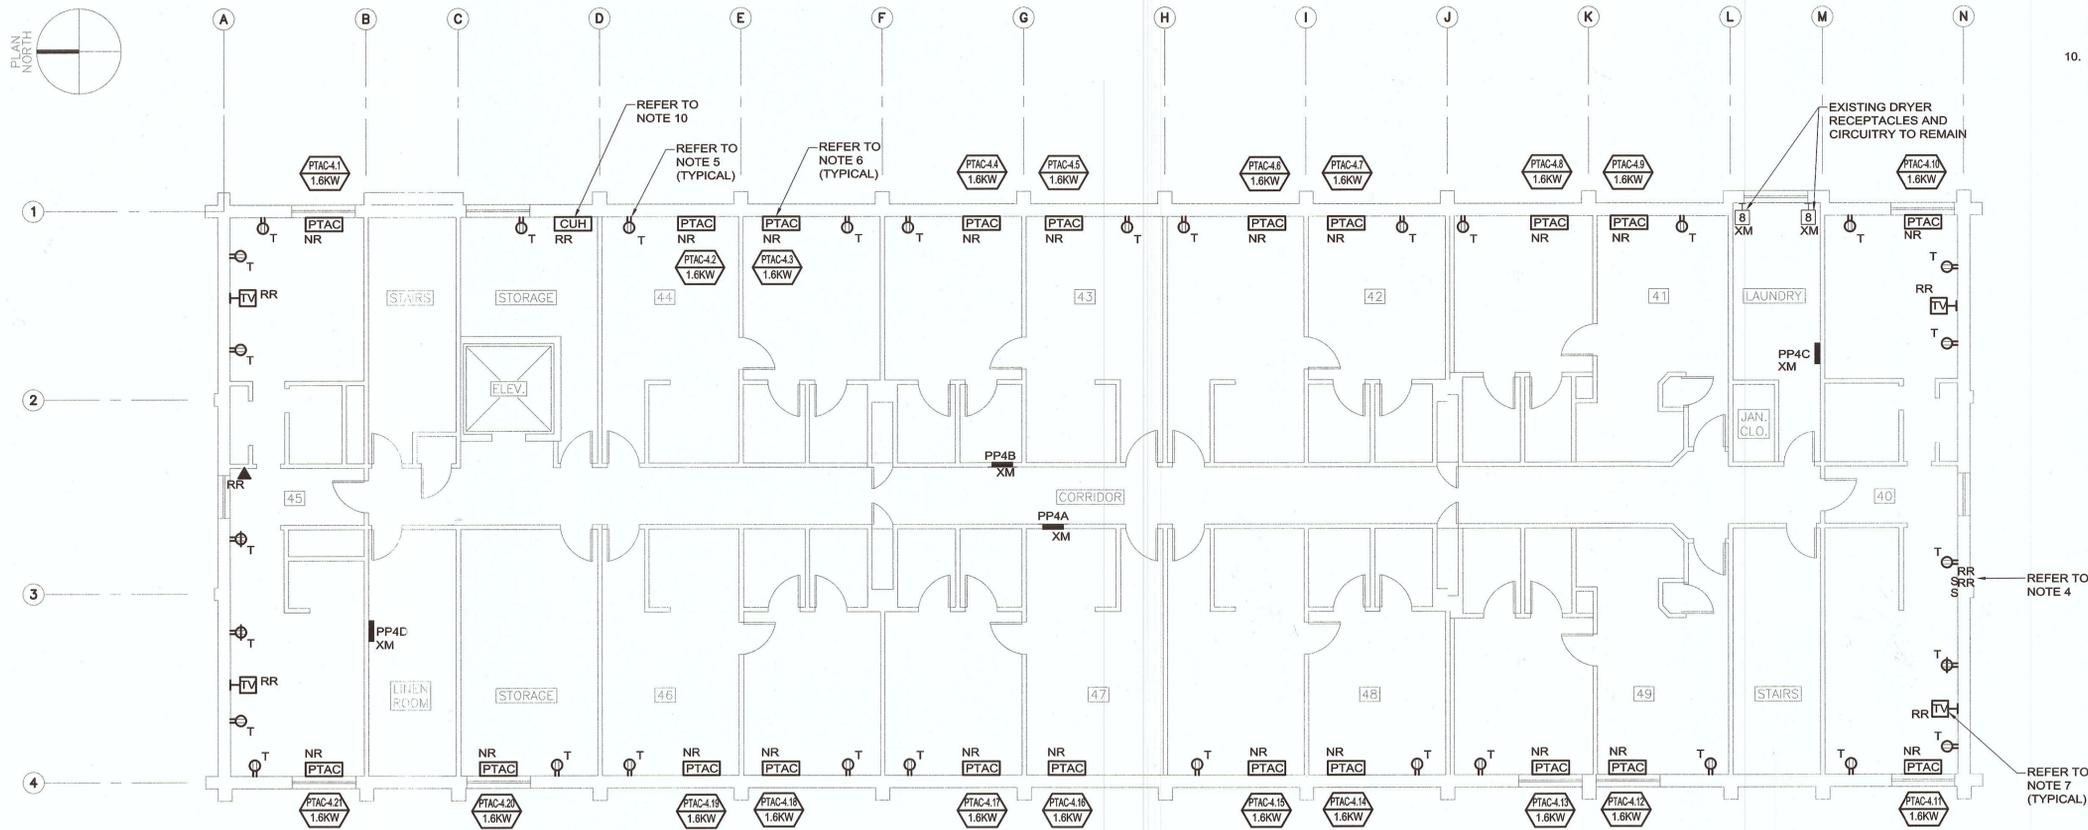

FOURTH FLOOR NEW WORK PLAN

LIGHTING AND POWER NOTES:

1. REFER TO DRAWING E000 FOR LEGEND AND SYMBOLS.
2. REFER TO ARCHITECTURAL DRAWINGS, INCLUDING BUT NOT LIMITED TO FLOOR PLANS AND ELEVATIONS FOR ASSOCIATED NOTES.
3. BRANCH CIRCUITRY MAY BE TYPE MC CABLE WHERE CONCEALED ABOVE SUSPENDED CEILINGS OR IN METAL STUD WALLS.
4. REINSTALL BACK BOX AND RECONNECT MULTIPLE GANG SWITCH AND COMMON FACE PLATE IN EXISTING LOCATION PRIOR TO DEMOLITION.
5. INSTALL NEW BACK BOX AND EXTEND/RECONNECT EXISTING BRANCH CIRCUIT PREVIOUSLY SERVING THE RECEPTACLE TO EXISTING LOCATION PRIOR TO DEMOLITION. RECONNECT BRANCH CIRCUIT TO NEW TAMPER RESISTANT RECEPTACLE AND INSTALL NEW COVER PLATE TO MATCH EXISTING.
6. EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING PTAC UNIT AND RECONNECT TO NEW PTAC UNIT AND ASSOCIATED CONTROLS. UNLESS INDICATED OTHERWISE THE PTAC UNITS WILL BE FURNISHED WITH INTEGRAL DISCONNECT SWITCH. NOTE THAT WIRING TO THE PTAC UNITS WILL BE THROUGH AN ELECTRICAL SUBBASE WHICH HOUSES THE UNIT DISCONNECT SWITCH.
7. REINSTALL BACK BOX AND RECONNECT/INSTALL TELEPHONE AND/OR TV OUTLET TO EXISTING LOCATION PRIOR TO DEMOLITION.
8. MAINTAIN CONTINUITY OF BRANCH CIRCUITRY ASSOCIATED WITH ALL EXISTING DEVICES AND LIGHTING TO REMAIN.
9. REINSTALL EXISTING RECEPTABLES, TELEPHONE/TV OUTLETS, COVER PLATES AND RECONNECT EXISTING BRANCH CIRCUIT WIRING FOR ALL INTERIOR WALL RECEPTABLES AND TELEPHONE/TV OUTLETS. REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR WALL ELEVATIONS FOR EXACT QUANTITIES AND LOCATIONS.
10. EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING CABINET UNIT HEATER AND RECONNECT TO REINSTALLED CABINET UNIT HEATER AND ASSOCIATED CONTROLS.

RDK ENGINEERS
 Andover, MA - Boston, MA - Amherst, MA
 Durham, NC - Charlotte, NC

RDK Engineers
 200 Brickstone Square
 Andover, MA 01810-1488
 T. 978-296-6200

NO.	DATE	DESCRIPTION

NAVFAC

GILBERT B. BROWN, JR.
 No. 7526
 PROFESSIONAL ENGINEER
 1943

GALE
 Gale Associates, Inc.
 Engineers - Planners
 163 LIBBEY PARKWAY
 WEYMOUTH, MA 02189
 P 781.335.6465
 F 781.335.6467 www.gainc.com
 Boston Baltimore Orlando San Francisco

GALE IN 824502 A/E: RFB

APPROVED

FOR COMMANDER NAVFAC

ACTIVITY

SATISFACTORY TO DATE APRIL 12, 2013

DESIGNER: fdeaco
 CHECKER: DNG/ARH

DEPARTMENT OF THE NAVY
 NAVAL FACILITIES ENGINEERING COMMAND
 NEWPORT, RI
 NAVAL STATION
 NEWPORT, RI
**EXTERIOR REPAIRS BUILDING 678
 CODDINGTON POINT**
 ELECTRICAL LIGHTING & POWER FOURTH FLOOR PLAN

SCALE: 1/8"=1'-0"

PROJECT NO.: 1116160

CONSTR. CONTR. NO.: N40065-11-D-7207-0502


NAVAC DRAWING NO.: 12642125

SHEET 64 OF 65

E104

DRAWING REVISION: 10 MARCH 2009

FILE NAME: J:\2011\20110571 - Newport Naval Station Bldg 678 Electrical\Electrical\Plot Sheets\20110571 - E105 ELECTRICAL LIGHTING & POWER FIFTH FLOOR PLAN.dwg PLOTTED: Wednesday, April 10, 2013 - 10:02:00am USER: ldeza

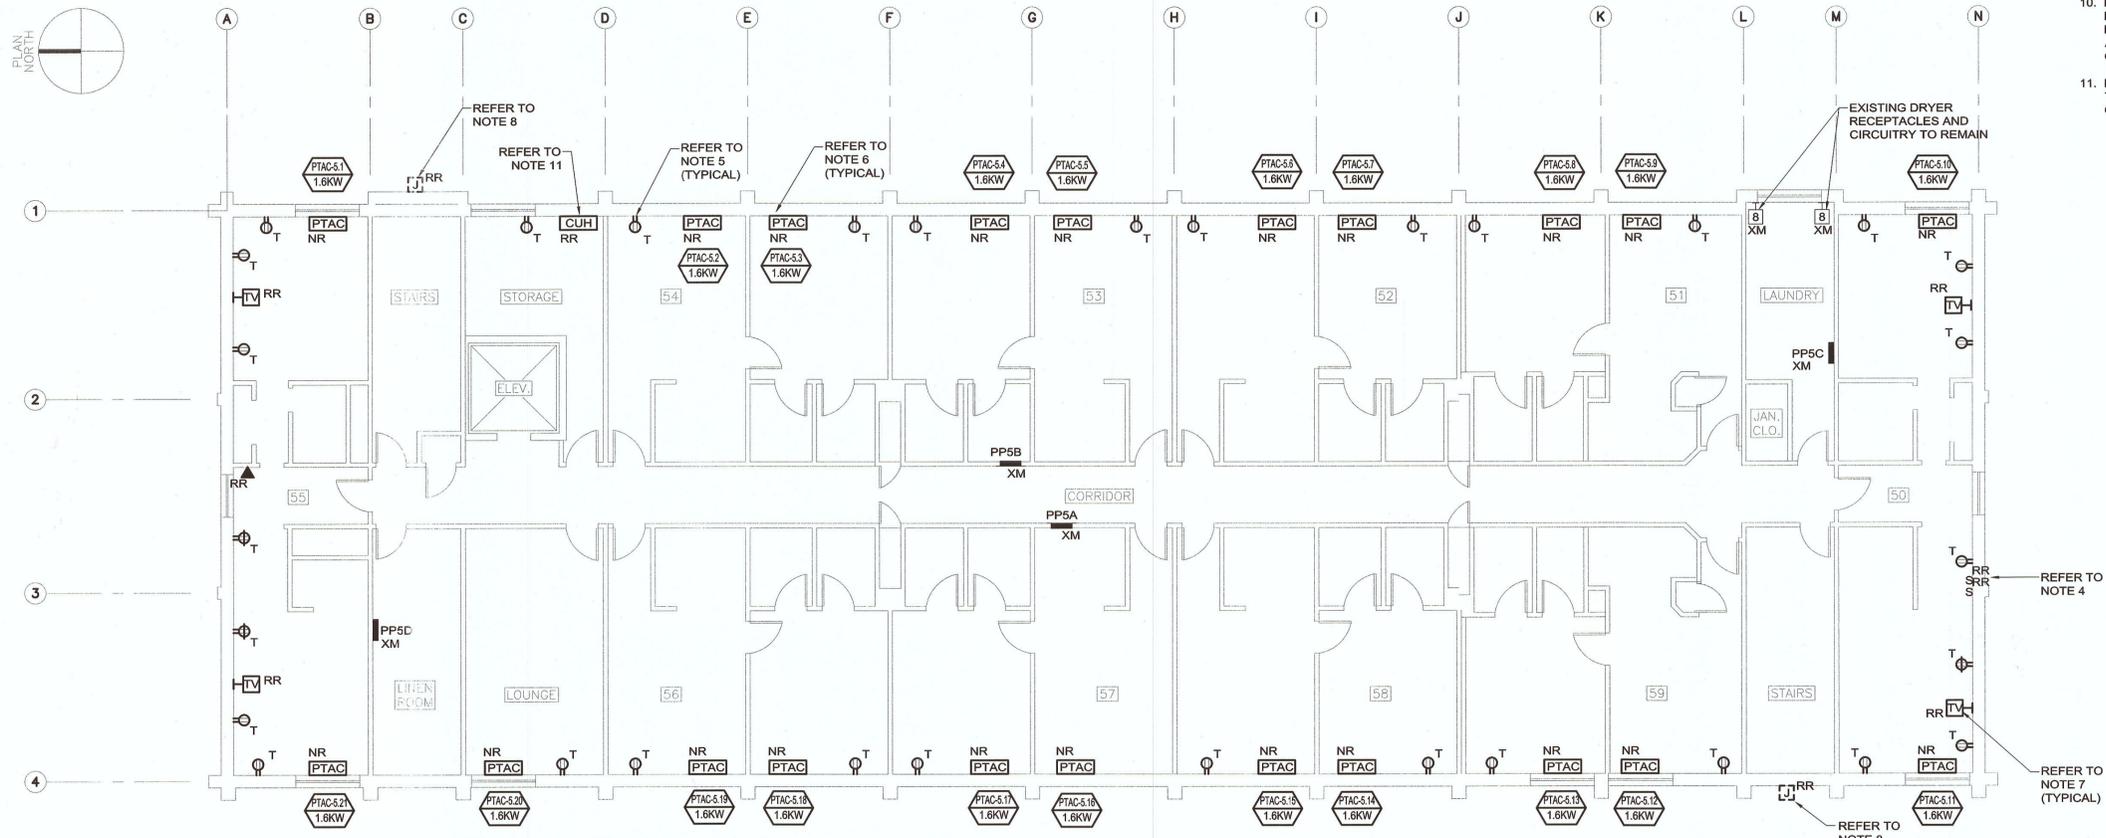

FIFTH FLOOR NEW WORK PLAN

- LIGHTING AND POWER NOTES:**
- REFER TO DRAWING E000 FOR LEGEND AND SYMBOLS.
 - REFER TO ARCHITECTURAL DRAWINGS, INCLUDING BUT NOT LIMITED TO FLOOR PLANS AND ELEVATIONS FOR ASSOCIATED NOTES.
 - BRANCH CIRCUITRY MAY BE TYPE MC CABLE WHERE CONCEALED ABOVE SUSPENDED CEILINGS OR IN METAL STUD WALLS.
 - REINSTALL BACK BOX AND RECONNECT MULTIPLE GANG SWITCH AND COMMON FACE PLATE IN EXISTING LOCATION PRIOR TO DEMOLITION.
 - INSTALL NEW BACK BOX AND EXTEND/RECONNECT EXISTING BRANCH CIRCUIT PREVIOUSLY SERVING THE RECEPTACLE TO EXISTING LOCATION PRIOR TO DEMOLITION. RECONNECT BRANCH CIRCUIT TO NEW TAMPER RESISTANT RECEPTACLE AND INSTALL NEW COVER PLATE TO MATCH EXISTING.
 - EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING PTAC UNIT AND RECONNECT TO NEW PTAC UNIT AND ASSOCIATED CONTROLS. UNLESS INDICATED OTHERWISE THE PTAC UNITS WILL BE FURNISHED WITH INTEGRAL DISCONNECT SWITCH. NOTE THAT WIRING TO THE PTAC UNITS WILL BE THROUGH AN ELECTRICAL SUBBASE WHICH HOUSES THE UNIT DISCONNECT SWITCH.
 - REINSTALL BACK BOX AND RECONNECT/INSTALL TELEPHONE AND/OR TV OUTLET TO EXISTING LOCATION PRIOR TO DEMOLITION.
 - RE-INSTALL WEATHERPROOF JUNCTION BOX/CONDUIT AND ANTENNA.
 - MAINTAIN CONTINUITY OF BRANCH CIRCUITRY ASSOCIATED WITH ALL EXISTING DEVICES AND LIGHTING TO REMAIN.
 - REINSTALL EXISTING RECEPTABLES, TELEPHONE/TV OUTLETS, COVER PLATES AND RECONNECT EXISTING BRANCH CIRCUIT WIRING FOR ALL INTERIOR WALL RECEPTABLES AND TELEPHONE/TV OUTLETS. REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR WALL ELEVATIONS FOR EXACT QUANTITIES AND LOCATIONS.
 - EXTEND THE EXISTING BRANCH CIRCUIT/CABLE PREVIOUSLY SERVING THE EXISTING CABINET UNIT HEATER AND RECONNECT TO REINSTALLED CABINET UNIT HEATER AND ASSOCIATED CONTROLS.

RDK ENGINEERS
 Andover, MA - Boston, MA - Amherst, MA
 Durham, NC - Charlotte, NC

RDK Engineers
 200 Brickstone Square
 Andover, MA 01810-1488
 T. 978-296-6200

DATE	APR
DESCRIPTION	
BY	

NAVFAC

GILBERT E. FLETCHER, JR.
 No. 7525
 PROFESSIONAL ENGINEER

GALE
 Gale Associates, Inc.
 Engineers Planners
 163 LIBBEY PARKWAY
 WEYMOUTH, MA 02189
 P 781.335.6465
 F 781.335.6467 www.gainc.com
 Boston Baltimore Orlando San Francisco

GALE JN 824502 A/E 010

FOR COMMANDER NAVFAC
 ACTIVITY

SATISFACTORY TO DATE APRIL 12, 2013
 DES DM DRW DM CHK GM

BRANCH MANAGER
 CHIEF ENG/ARCH

DEPARTMENT OF THE NAVY
 NAVAL FACILITIES ENGINEERING COMMAND
 NAVAL STATION
 NEWPORT, RI
 NEWPORT, RI
 EXTERIOR REPAIRS BUILDING 678
 CODDINGTON POINT
 ELECTRICAL LIGHTING & POWER FIFTH FLOOR PLAN

SCALE: 1/8"=1'-0"
 PROJECT NO.: 1110180
 CONSTR. CONTR. NO.: N40085-11-D-7207-0502
 NAVFAC DRAWING NO.: 12642126
 SHEET 65 OF 66
 E105
 DOWNGRADE REVISIONS TO MARCH 2009