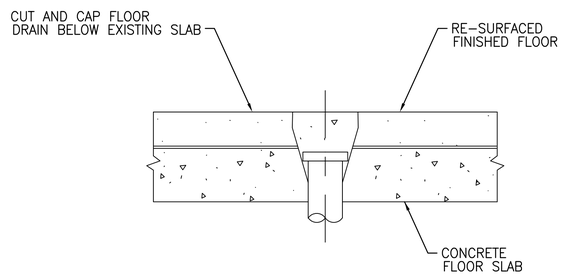

1 FLOOR DRAIN CAP DETAIL

N.T.S. PD401

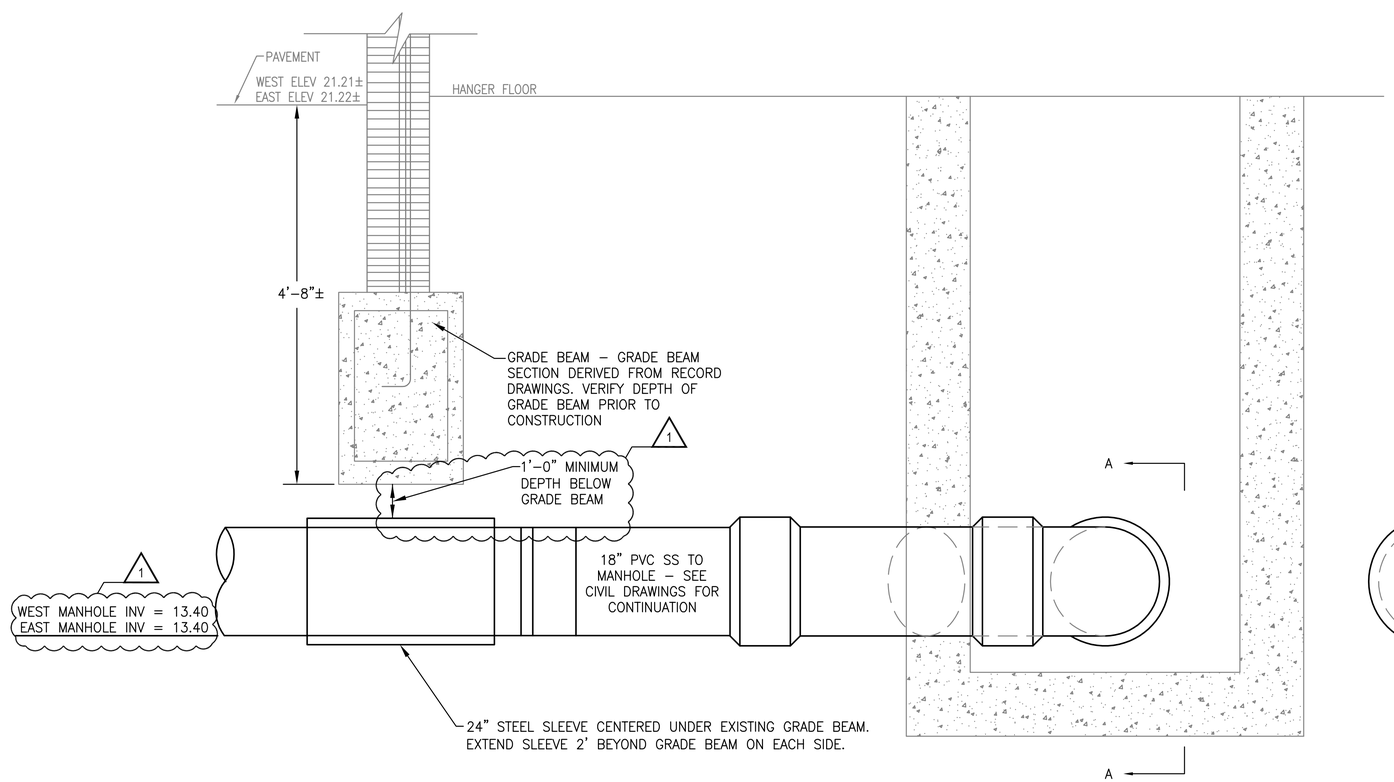

NOTE:
1. PROVIDE FUEL RESISTANT JOINT SEAL PER ASTM D7116.
2. PROVIDE SCHEDULE 40 PVC DWV WITH BELL AND SPIGOT JOINTS.

2 PIPE UNDER GRADE BEAM

N.T.S. PD101–PD103

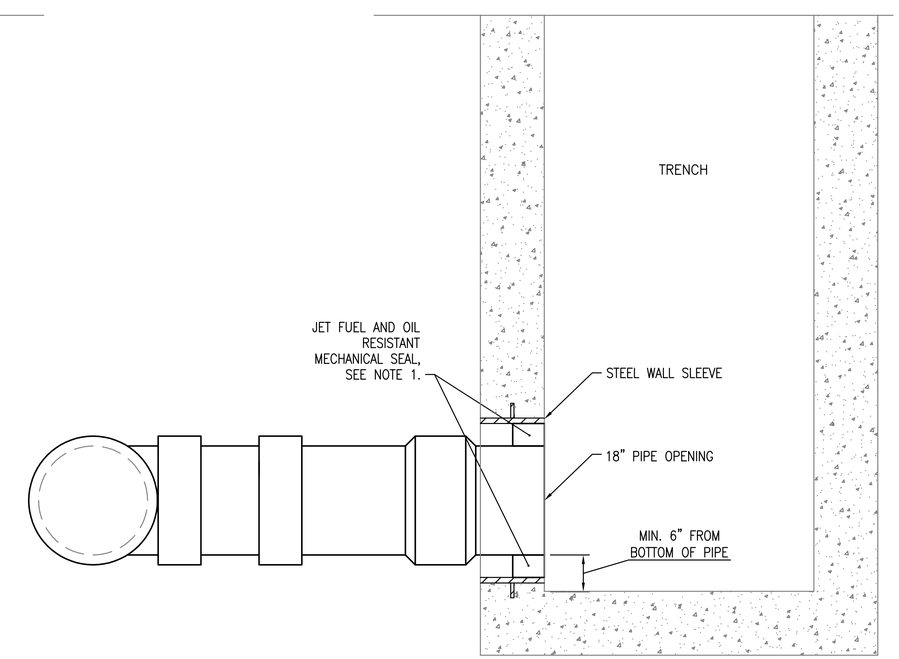

SECTION 'A'

SYM	DESCRIPTION	DATE	APPR
1	GRADE BEAM CLEARANCE	5/12/2016	
	FINAL SUBMISSION	5/2/2016	

NAVFAC

COMMONWEALTH OF VIRGINIA REGISTERED PROFESSIONAL ENGINEER ROBERT H. GOULD 037425 5/12/16 SEAL

the PROTECTION ENGINEERING GROUP
14585 Avion Parkway, Suite 150 703-488-9990
Chantilly, Virginia 20151 fax: 703-488-9994
www.PEGroup-Inc.com

A/E INFO

APPROVED

FOR COMMANDER NAVFAC

ACTIVITY

SATISFACTORY TO

DES. NM DRW KM CHK RG

PM/OM KPL/IAS

BRANCH MANAGER

CHIEF ENG/ARCH Mark J. Airaghi, PE

FIRE PROTECTION

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING COMMAND
NAVAL FACILITIES ENGINEERING COMMAND ~ MID-ATLANTIC
HAMPTON ROADS PT.
NAS OCEANA – VIRGINIA BEACH, VIRGINIA
NAVAL AIR STATION OCEANA
VIRGINIA BEACH, VIRGINIA

HANGAR 111 FIRE PROTECTION AND STRUCTURAL REPAIRS

DETAILS - PLUMBING

SCALE: NO SCALE
EPROJECT NO.: 1372146
CONSTR. CONTR. NO.
NAVFAC DRAWING NO. 12716363
SHEET 141 OF 170

P-501

DRAWFORM REVISION: 10 MAY 2014

FILE NAME: P:\Projects\GHDC\GHDC1501-NAVFAC Hangar 111\DESIGN\M\1372146_P-501.dwg LAYOUT NAME: P501 PLOTTED: Thursday, May 12, 2016 - 2:25pm USER: nmorcella