
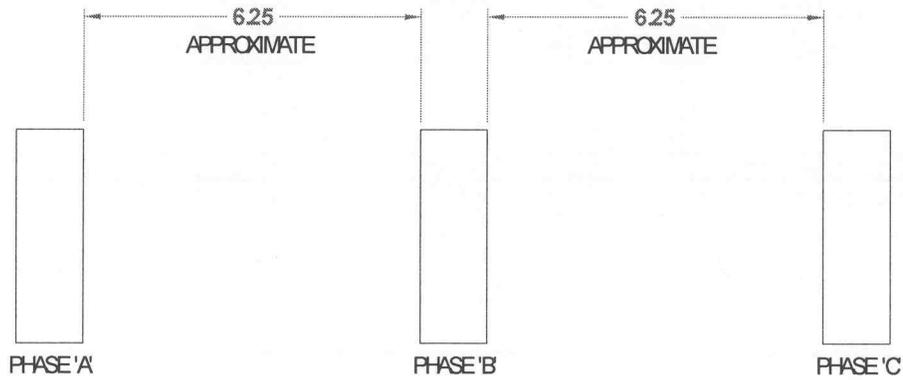


**FIGURE 1
BUS BAR ARRANGEMENT**

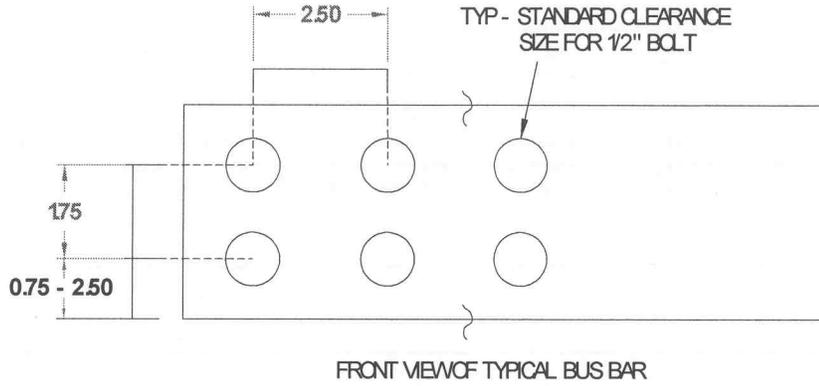

SIDE OR CUTAWAY VIEW OF COPPER BUS BARS

ADEQUATE SPACING SHALL BE PRESENT BETWEEN PHASES TO ALLOW FOR 500/900 KCMIL LUGS TO BE PLACED ONTO BOTH SIDES OF EACH BUS BAR/PHASE (BACK-TO-BACK) AND STILL MEET THE 480 VAC CLEARANCE REQUIREMENTS BETWEEN ALL THREE PHASES.